


## DIAGRAMMA PRESTAZIONI

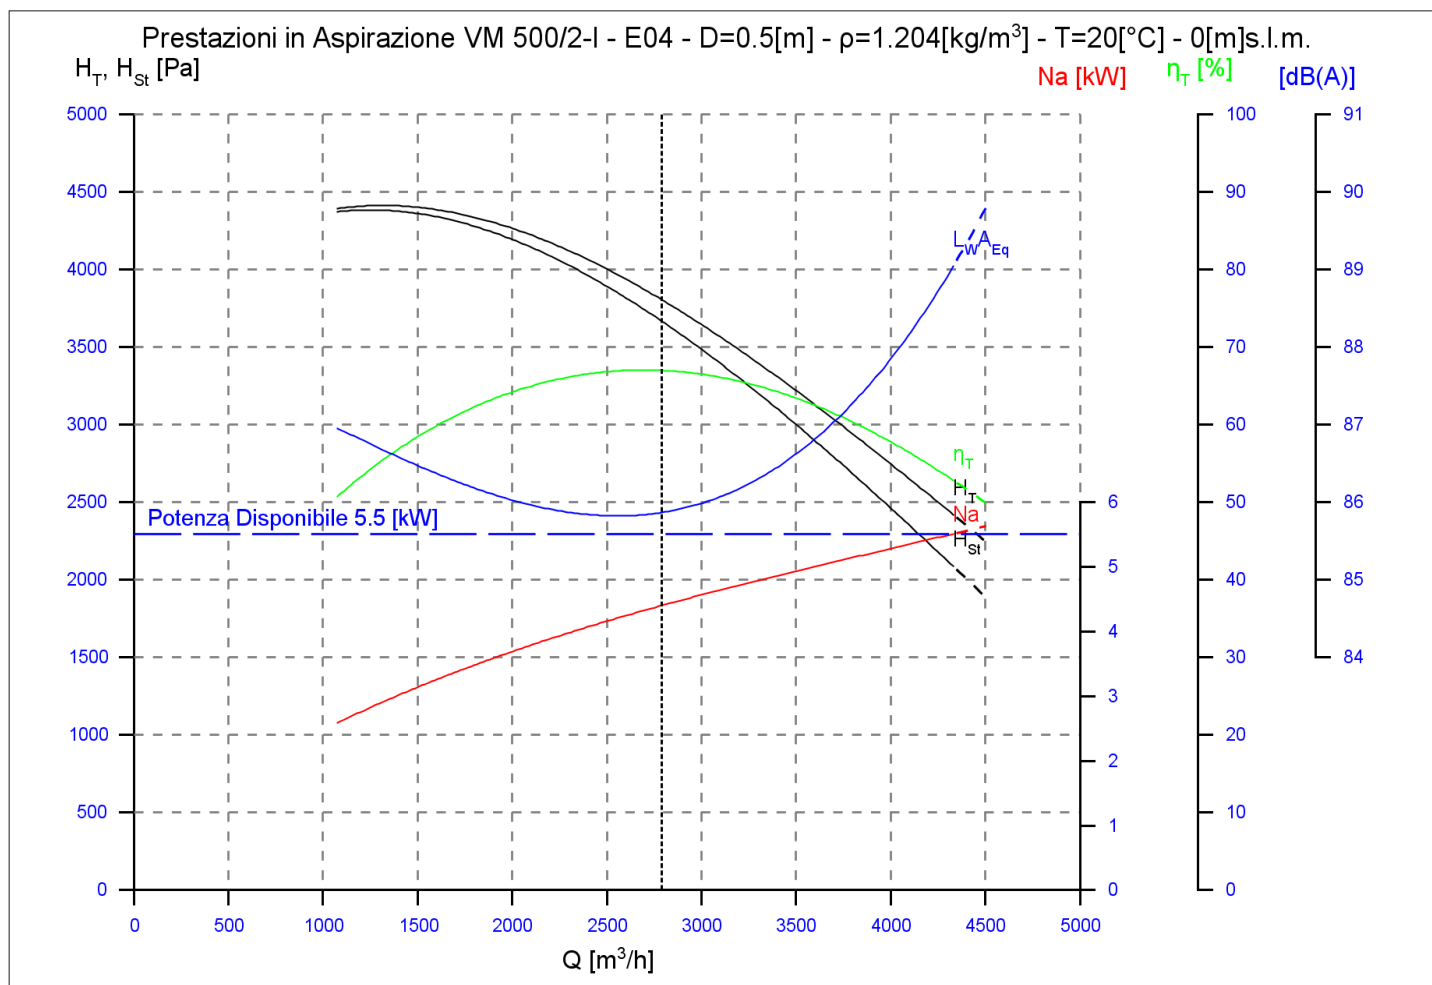

<b>VM 500/2-I</b>	$\rho = 1.204[\text{kg/m}^3]$	$\rho = 1.204[\text{kg/m}^3]$	<b>Warning</b>
	a 20[°C], 0[m]s.l.m.	a 20[°C], 0[m]s.l.m.	
Q [m <sup>3</sup> /h]	2788		
NQ [Nm <sup>3</sup> /h]	2598		
H <sub>T</sub> [Pa]	3805	3805	
H <sub>st</sub> [Pa]	3667	3667	
Na [kW]	4.4	4.4	
Ne [kW]	4.4	4.4	
η <sub>T</sub> [%]	66.98		
L <sub>WA</sub> [dB(A)]	85.87	85.87	
LA <sub>Eq</sub> [dB(A)]	72.57		

RPM [ ]	2950	Limiti RPM [ ]	<=60 °C: 4500
Frequenza [Hz]	50	Esecuzione	E04
Φ Girante [mm]	500	Classe	I

Misurato in campo libero e 1.5 [m] distanza dalla chiocciola del ventilatore in accordo con ISO3744. Tolleranza ±3 [dB(A)]