


## DIAGRAMMA PRESTAZIONI

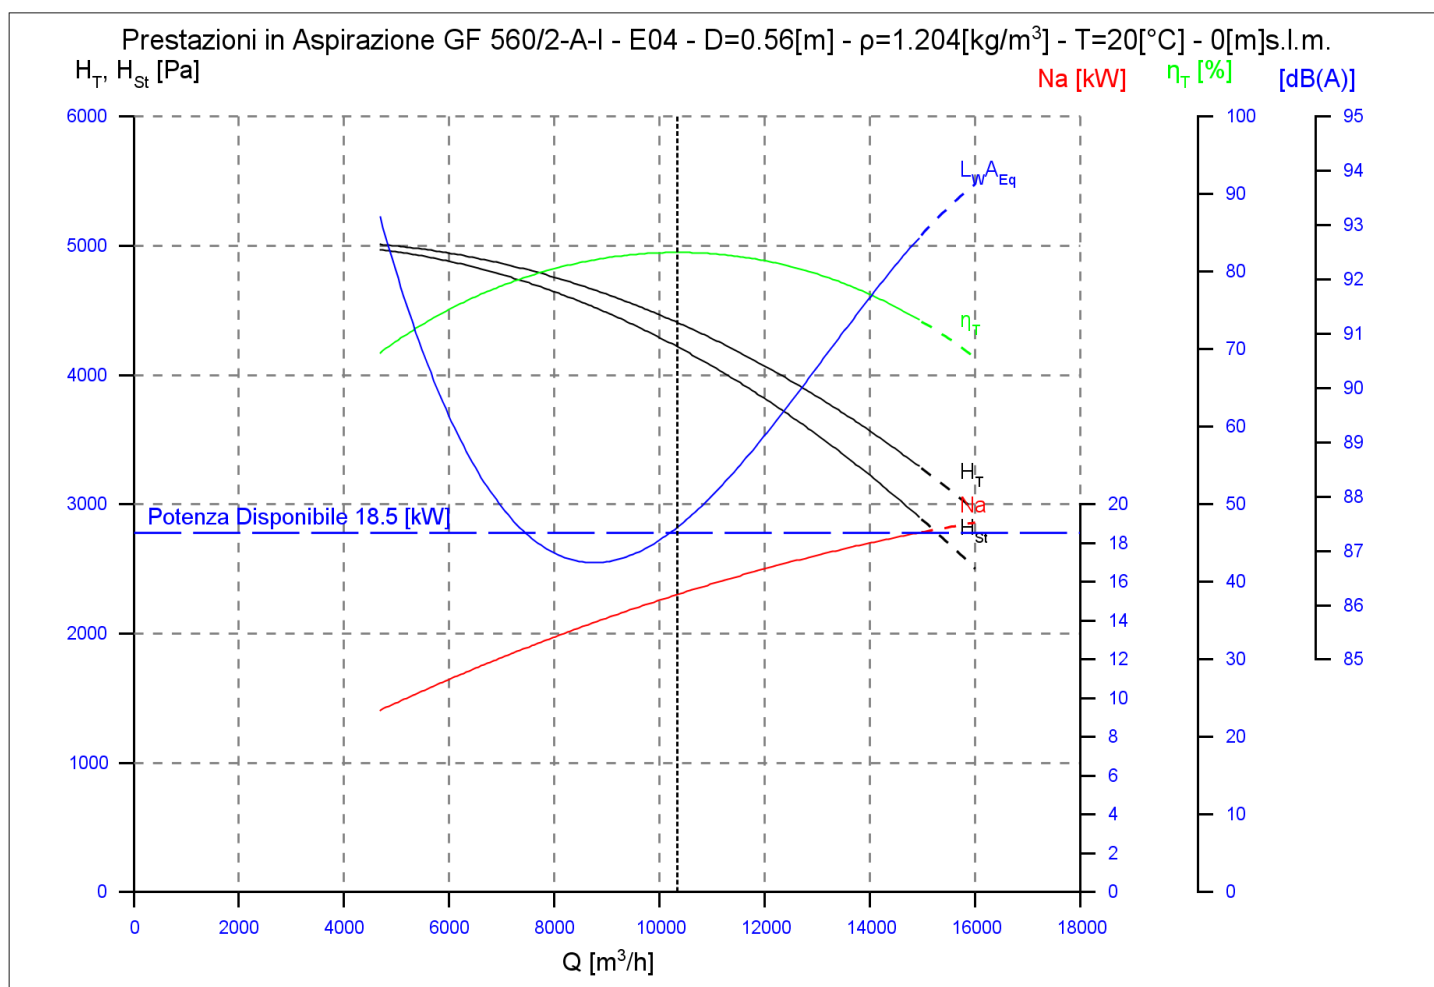

<b>GF 560/2-A-I</b>	$\rho = 1.204[\text{kg/m}^3]$ a 20[°C], 0[m]s.l.m.	$\rho = 1.204[\text{kg/m}^3]$ a 20[°C], 0[m]s.l.m.	<b>Warning</b>
Q [m <sup>3</sup> /h]	10340		
NQ [Nm <sup>3</sup> /h]	9635		
H <sub>T</sub> [Pa]	4404	4404	
H <sub>St</sub> [Pa]	4216	4216	
Na [kW]	15.341	15.341	
Ne [kW]	15.341	15.341	
η <sub>T</sub> [%]	82.45		
L <sub>W</sub> A <sub>Eq</sub> [dB(A)]	87.43	87.43	
LA <sub>Eq</sub> [dB(A)]	74.13		

RPM []	2960	Limiti RPM []	≤60 °C: 3200
Frequenza [Hz]	50	Esecuzione	E04
Φ Girante [mm]	560	Classe	I

Misurato in campo libero e 1.5 [m] distanza dalla chiocciola del ventilatore in accordo con ISO3744. Tolleranza ±3 [dB(A)]