


## DIAGRAMMA PRESTAZIONI

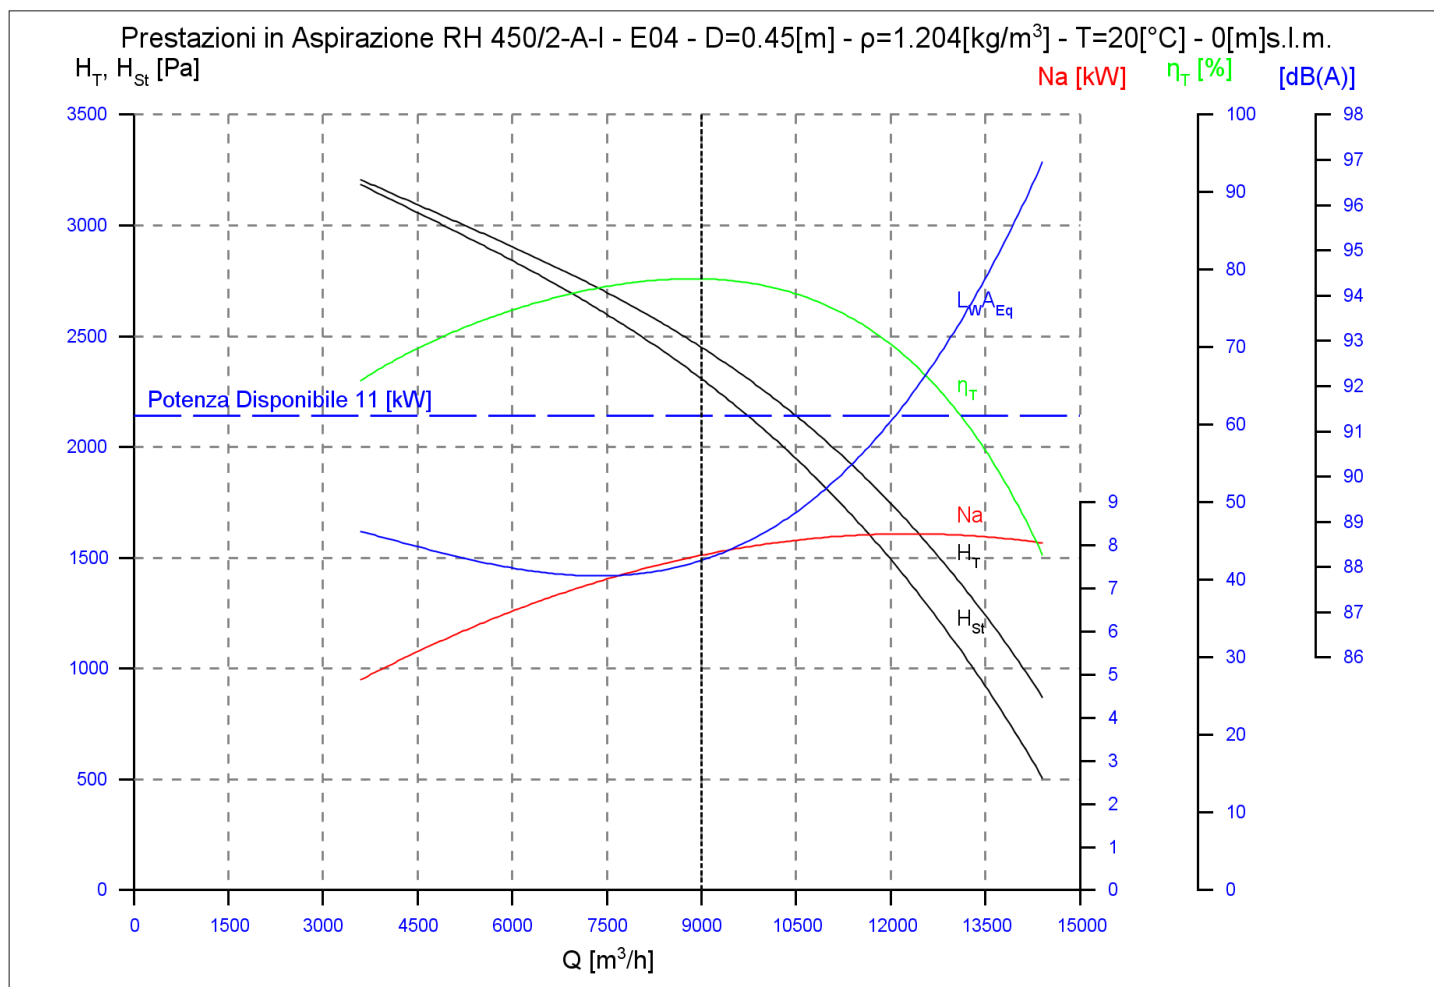

<b>RH 450/2-A-I</b>	$\rho = 1.204[\text{kg/m}^3]$ a 20[°C], 0[m]s.l.m.	$\rho = 1.204[\text{kg/m}^3]$ a 20[°C], 0[m]s.l.m.	<b>Warning</b>
Q [m <sup>3</sup> /h]	9000		
NQ [Nm <sup>3</sup> /h]	8386		
H <sub>T</sub> [Pa]	2448	2448	
H <sub>St</sub> [Pa]	2305	2305	
N <sub>a</sub> [kW]	7.767	7.767	
N <sub>e</sub> [kW]	7.767	7.767	
$\eta_T$ [%]	78.79		
L <sub>WA_Eq</sub> [dB(A)]	88.14	88.14	
LA <sub>Eq</sub> [dB(A)]	74.84		

RPM [ ]	2955	Limiti RPM [ ]	≤60 °C: 3050
Frequenza [Hz]	50	Esecuzione	E04
Φ Girante [mm]	450	Classe	I

Misurato in campo libero e 1.5 [m] distanza dalla chiocciola del ventilatore in accordo con ISO3744. Tolleranza ±3 [dB(A)]